


RESIDENTIAL DRIVE WAY STANDARDS


TYPE A DESIGN

CITY OF EL DORADO, KANS.

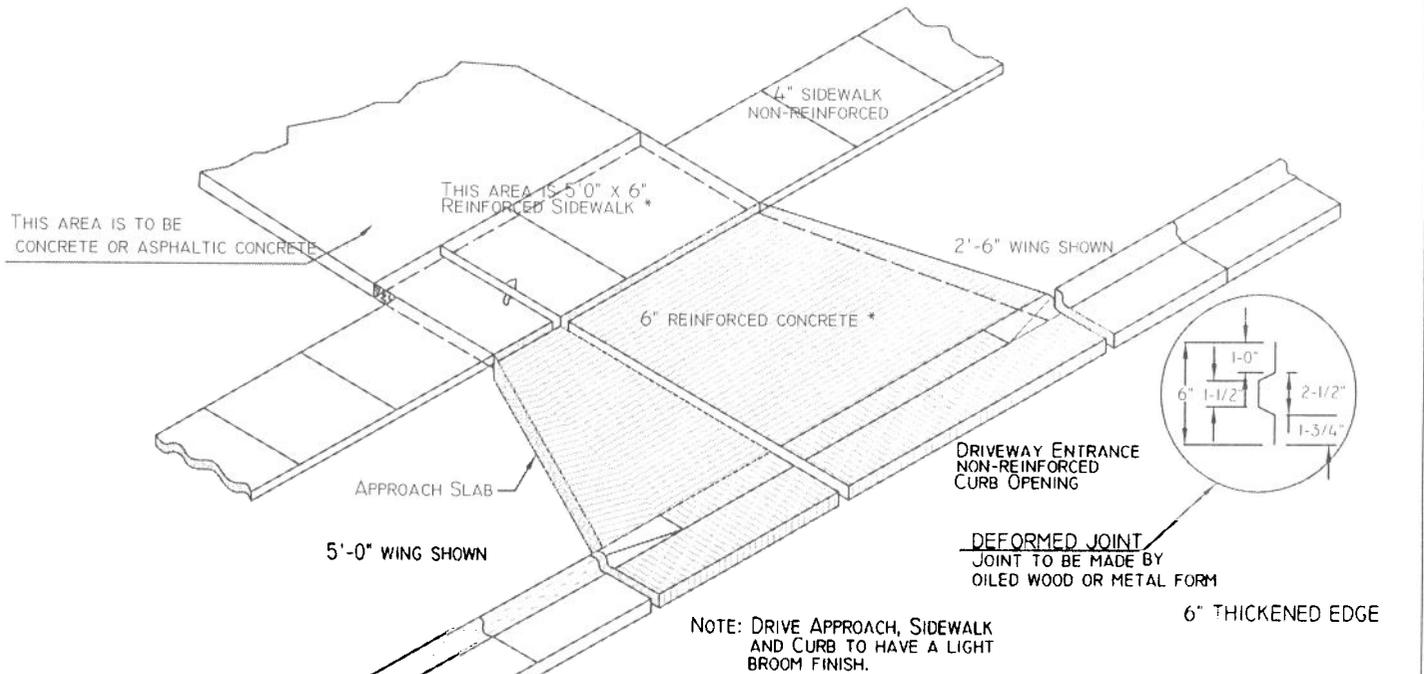

NOTE: DRIVE APPROACH, SIDEWALK AND CURB TO HAVE A LIGHT BROOM FINISH.

---SPECIAL NOTE---
 CITY PROJECTS REQUIRE CONTRACTORS TO USE A CLASS A, AE CONCRETE MIX, P.S.I. 4000.
 THIS IS SIMILAR TO A 6 SACK SMALL ROCK MIX WITH AIR ADDED. THIS MIX IS ALSO RECOMMENDED FOR HOME USE.
 A VIBRATOR OR SIMILAR DEVICE WILL BE REQUIRED FOR ALL APPROACH AREAS.

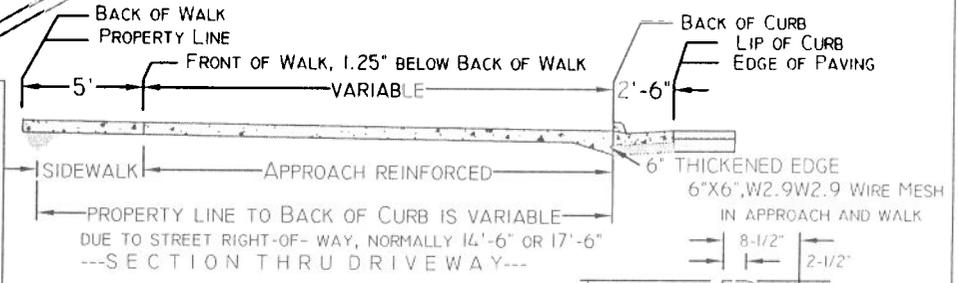

NOTE:
 6" REINFORCED CONCRETE, *
 6"x6", W2.9xW2.9 WIRE MESH MUST BE PLACED IN ALL NEW DRIVEWAY ENTRANCES, ACROSS ALL SIDEWALKS AND IN ALL APPROACH SLABS.

NOTE:
 MAXIMUM GRADE FROM FLOWLINE OF CURB AND GUTTER TO FRONT OF WALK IS 1-1/4" RISE PER FT. OF TRAVEL, OR 11" ABOVE TOP OF CURB. MINIMUM GRADE FROM FLOWLINE OF CURB AND GUTTER TO FRONT OF WALK IS 1/2" RISE PER FOOT OF TRAVEL, OR 1" ABOVE TOP OF CURB.

4' WALKS SHALL BE CUT THROUGH AT 4'0" INTERVALS.
 A 3/4" ASPHALTIC EXPANSION JOINT SHALL BE PLACED AT 50' INTERVALS AND WHEN ABUTTING ANY CURB.

